


PSV DATA

MFG: FARRIS
 MODEL: 26JA13-120/SP
 SERIAL: CE-43315-3-A10
 SET PRES: 9928 kPa
 CAPACITY: 35894 scfm
 SERVICED BY: DALCO
 SERVICE DATE: 07/2003
 SIZE: 2.5"x4"
 CODE STAMP: UV/NB
 BLOCK VALVE: NO
 CRN: OG2369.5C
 LOCATION: TOP SHELL
 TAG: N/S

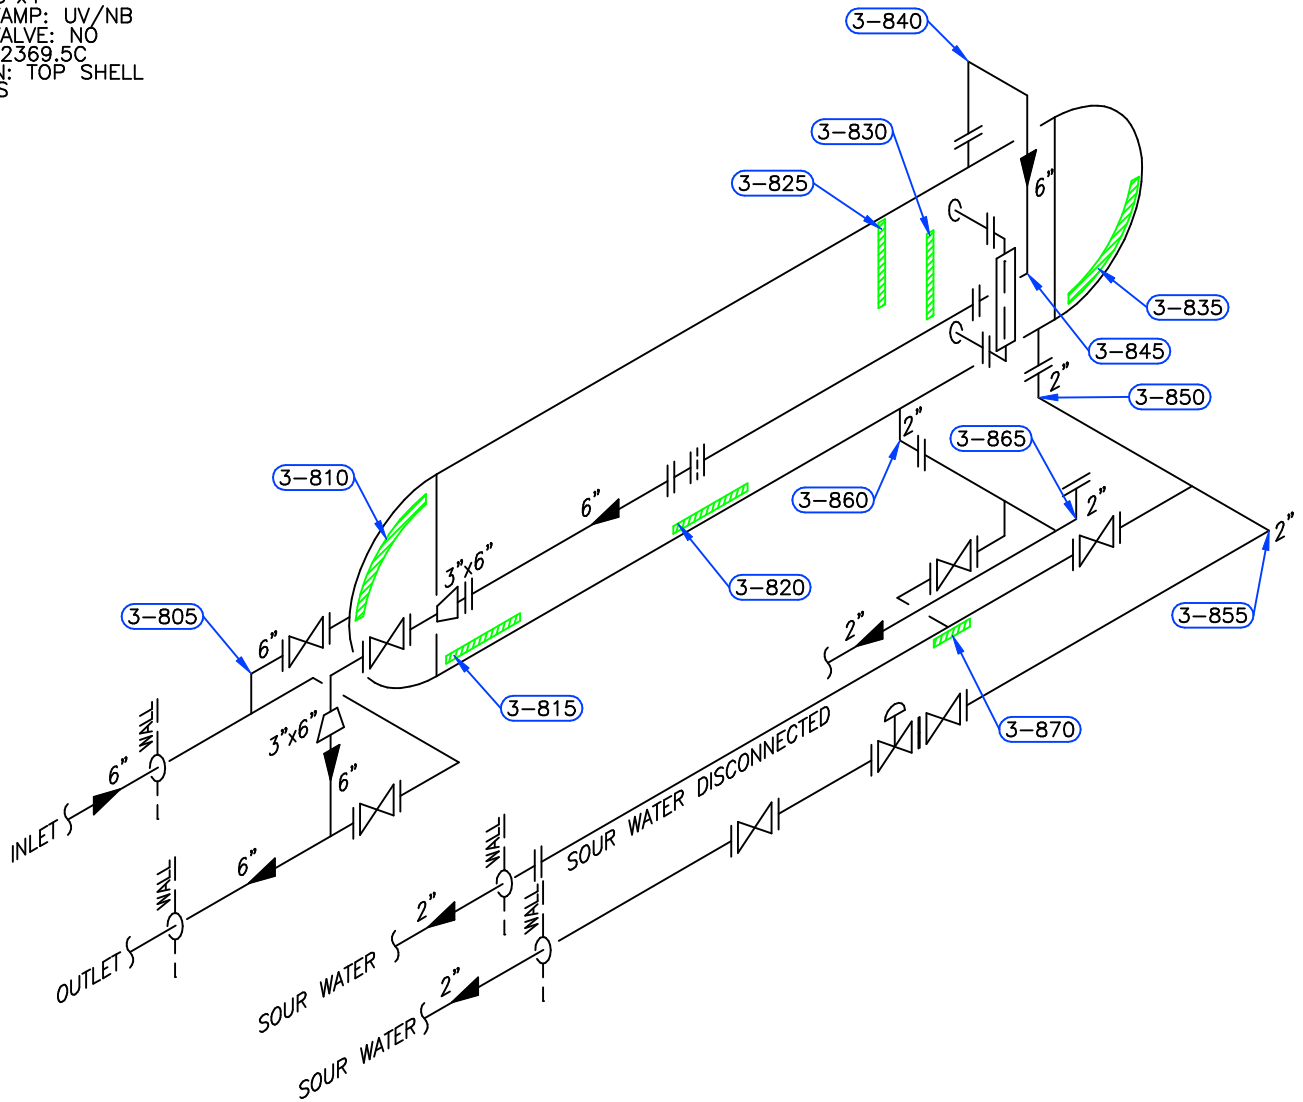

Equip. No. _____ Prov. Reg. No. Ⓐ 416035 C.R.N. N-2385.213 Serial No. 4626 Yr. Inst. _____
 Code/Div. ASME VIII, DIV 1 Size: 36in x 10ft Manufacturer: PENFABCO LTD Yr. Blt. 1996
 C. Stamp: U Service: SOUR PWHT: HT Radiography: RT-1 Insulated: NO

Design & Materials Data

HEAD:
 Top Mat'l. SA 516 70N Top Nom. 41.3mm Top C.A. 3.2mm
 Btm. Mat'l. _____ Btm. Nom. _____ Btm. C.A. _____

CHANNEL:
 Material: _____ Nominal: _____ C.A. _____

BOOT
 Head Mat'l. _____ Head Nom. _____ Head C.A. _____
 Shell Mat'l. _____ Shell Nom. _____ Shell C.A. _____

SHELL
 Material: SA 516 70N Nominal: 40.5mm C.A. 3.2mm

MAWP Shell Side: 9928 kPa @ Temp. 54°C
 MAWP Tube Side: _____ @ Temp. _____

CLIENT	CANADIAN NATURAL RESOURCES LTD	
FACILITY	ADSETT GAS GATHERING LSD b-63-G/94-J-02	
ITEM	HORIZONTAL SEPARATOR	
BY: JH	DATE: 07/2018	DWG.# 3-8

UTS DATA

CLIENT: CANADIAN NATURAL RESOURCES
EQUIPMENT: HORIZONTAL SEPARATOR
CRN#: N-2385.213
PROV REG: A 416035
TESTED ON STREAM

FACILITY: ADSETT GAS PLANT
SERVICE: SOUR
LOCATION: b-63-G/94-J-2
RTD JOB #: 10.180106
REFER TO DRAWING: 3-8

Test Point	THICKNESS DATA				Flag	T-Min	C.A.	Nom.	Short Term	Long Term	Ave. mm/py	Retirement Date
3-810												
Description: UPPER HEAD												
2018 7												
Min. Thick.	40.8	38.10	34.8	3.2	41.30				0	0		2282
Average:	41.5											
Analysis: 07/2018 - MIN SCAN @ KNUCKLE												
3-815												
Description: BOTTOM SHELL												
2018 7												
Min. Thick.	41.3	37.30		3.2	40.50				0	0		
Average:	41.4											
Analysis:												
3-820												
Description: BOTTOM SHELL												
2018 7												
Min. Thick.	41.2	37.30		3.2	40.50				0	0		
Average:	41.3											
Analysis:												
3-825												
Description: UPPER SHELL												
2018 7												
Min. Thick.	41.9	37.30		3.2	40.50				0	0		
Average:	42											
Analysis:												
3-830												
Description: MID SHELL												
2018 7												
Min. Thick.	41.2	37.30		3.2	40.50				0	0		
Average:	41.3											
Analysis:												
3-835												
Description: BOTTOM HEAD												
2018 7												
Min. Thick.	40.9	38.10		3.2	41.30				0	0		
Average:	41.6											
Analysis: 07/2018 - MIN SCAN @ KNUCKLE												

UTS DATA

CLIENT: CANADIAN NATURAL RESOURCES
EQUIPMENT: HORIZONTAL SEPARATOR PIPING
CRN#:
PROV REG:
TESTED ON STREAM

FACILITY: ADSETT GAS PLANT
SERVICE: SOUR
LOCATION: b-63-G/94-J-2
RTD JOB #: 10.180106
REFER TO DRAWING: 3-8

Test Point	THICKNESS DATA				Flag	T-Min	C.A.	Nom.	Short Term	Long Term	Ave. mm/py	Retirement Date
3-840												
Description: 6" 90° ELBOW												
2018 7												
Min. Thick.	10.9	9.63	1.4	11.00					0	0		
Average:	11.3											
Analysis:												
3-845												
Description: 6" 90° ELBOW												
2018 7												
Min. Thick.	10	9.63	1.4	11.00					0	0		
Average:	10.5											
Analysis:												
3-850												
Description: 2" 90° ELBOW												
2018 7												
Min. Thick.	7.8	7.61	1.1	8.70					0	0		
Average:	8.1											
Analysis:												
3-855												
Description: 2" 90° ELBOW												
2018 7												
Min. Thick.	8	7.61	1.1	8.70					0	0		
Average:	8.4											
Analysis:												
3-865												
Description: 2" 90° DEADLEG												
2018 7												
Min. Thick.	7.9	7.61	1.1	8.70					0	0		
Average:	8.2											
Analysis:												
3-870												
Description: 2"x2" TEE												
2018 7												
Min. Thick.	9.4	7.61	1.1	8.70					0	0		
Average:	11.4											
Analysis: 07/2018 - PITTING NOTED.												

UTS DATA

CLIENT: CANADIAN NATURAL RESOURCES
EQUIPMENT: HORIZONTAL SEPARATOR PIPING
CRN#:
PROV REG:
TESTED ON STREAM

FACILITY: ADSETT GAS PLANT
SERVICE: SOUR
LOCATION: b-63-G/94-J-2
RTD JOB #: 10.180106
REFER TO DRAWING: 3-8

Test Point	THICKNESS DATA				Flag	T-Min	C.A.	Nom.	Short Term	Long Term	Ave. mm/py	Retirement Date
3-875												
Description:	3" 90° ELBOW											
	2018 7											
Min. Thick.	7.8			6.65		1	7.60					
Average:	8.1								0		0	
Analysis:												
