


PSV DATA

MFG: FARRIS
 MODEL: 26MA-120
 SERIAL: 576567-1-A10
 SET PRES: 344 kPa
 CAPACITY: 4384 SCFM
 SERVICED BY: N/S
 SERVICE DATE: 02/2011
 SIZE: 4" x 6"
 CODE STAMP: UV
 BLOCK VALVE: NO
 CRN: N/S
 LOCATION: TOP SHELL
 TAG: N/S

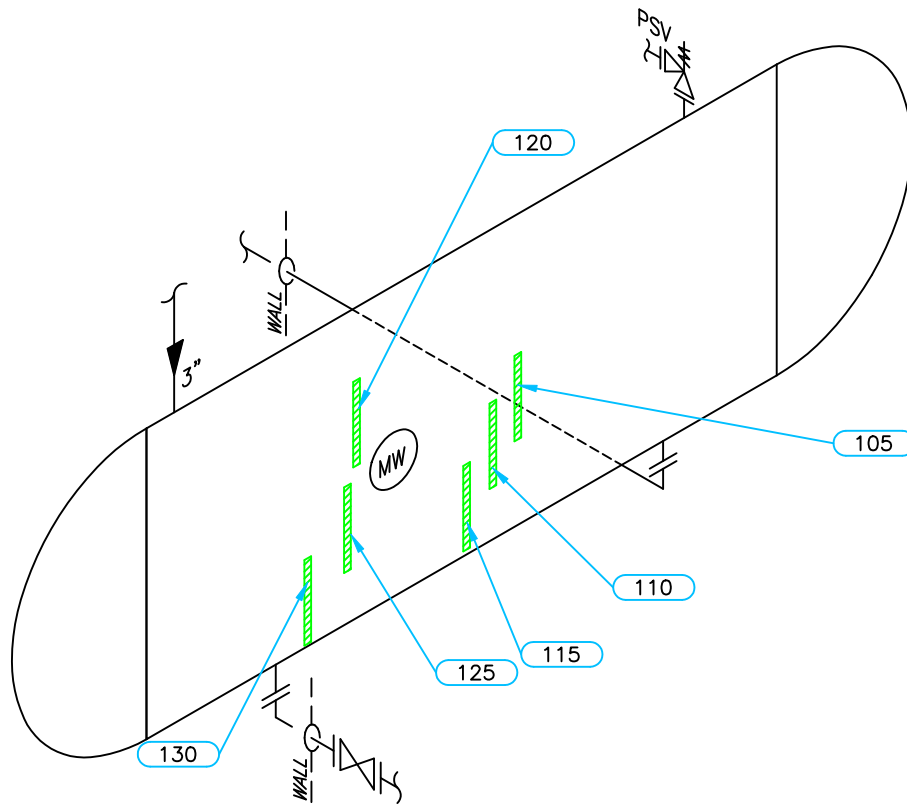

Equip. No. _____ Prov. Reg. No. **Ⓐ 573597** C.R.N. **R-8253.21** Serial No. **15624** Yr. Inst. _____
 Code/Div. **ASME VIII, Div 1** Size: **96in x 40ft** Manufacturer: **BILTON** Yr. Bld. **2010**
 C. Stamp: **U** Service: **SOUR** PWHT: **NIL** Radiography: **NIL** Insulated: **YES**

Design & Materials Data

HEAD:
 Top Mat'l. **SA 516 70N** Top Nom. **7.9mm** Top C.A. **3.2mm**
 Btm. Mat'l. _____ Btm. Nom. _____ Btm. C.A. _____
CHANNEL:
 Material: _____ Nominal: _____ C.A. _____
BOOT
 Head Mat'l. _____ Head Nom. _____ Head C.A. _____
 Shell Mat'l. _____ Shell Nom. _____ Shell C.A. _____
SHELL
 Material: **SA 516 70N** Nominal: **9.5mm** C.A. **3.2mm**
 MAWP Shell Side: **344 kPa** @ Temp. **38°C**
 MAWP Tube Side: _____ @ Temp. _____

CLIENT	CANADIAN NATURAL RESOURCES	
FACILITY	UMBACH FIELD LSD c-37-F/94-H-03	
ITEM	CONDENSATE STORAGE BULLET	
BY: CW	DATE: 03/2012	DWG.# 32

UTS DATA

CLIENT: CANADIAN NATURAL RESOURCES
EQUIPMENT: CONDENSATE STORAGE BULLET
CRN#: R-8253.21
PROV REG: A 573597
TESTED ON STREAM

FACILITY: UMBACH FIELD
SERVICE: SOUR
LOCATION: c-37-F/94-H-03
RTD JOB #: 10.111395
REFER TO DRAWING: 32

Test Point	THICKNESS DATA				Flag	T-Min	C.A.	Nom.	Short Term	Long Term	Ave. mm/py	Retirement Date
105												
Description:	UPPER SHELL											
	2012 3											
Min. Thick.	9.8	6.30	3.2	9.50					0	0		
Average:	10											
Analysis:												
110												
Description:	LOWER SHELL											
	2012 3											
Min. Thick.	9.8	6.30	3.2	9.50					0	0		
Average:	10											
Analysis:												
115												
Description:	BOTTOM SHELL											
	2012 3											
Min. Thick.	10	6.30	3.2	9.50					0	0		
Average:	10.4											
Analysis:												
120												
Description:	MID SHELL											
	2012 3											
Min. Thick.	10	6.30	3.2	9.50					0	0		
Average:	10.1											
Analysis:												
125												
Description:	LOWER SHELL											
	2012 3											
Min. Thick.	10.2	6.30	3.2	9.50					0	0		
Average:	10.3											
Analysis:												
130												
Description:	LOWER SHELL											
	2012 3											
Min. Thick.	10.2	6.30	3.2	9.50					0	0		
Average:	10.3											
Analysis:	2012/03 MIN SCAN @ 6:00 POSITION.											