


EF-1103
BUILDING EXHAUST FAN
MAKE:
MODEL: 6.A.C.P.H.
DUTY: 120VAC, 60Hz
CLASS: 1, DIV. 1
EXPLOSION PROOF

UH-1101/1102
BUILDING HEATERS
MAKE: CATADYNE
DUTY: 24,000 BTU/HR
C/W SAFETY SHUTOFF, 912 REGULATOR
THERMOSTAT, GRILL GUARD
120 VOLT START, VENT HOOD
NATURAL GAS SUPPLY

V-1100
3 PHASE HORIZONTAL SEPARATOR
SIZE: 1219 mm (48") I.D. x 4877mm (16'-0") S/S
D.P.: 4827 kPag (700psig) @ 71°C (160°F)
CA: 3.2mm (1/8")
X-RAY: RT-2, MDMT -29°C (-20°F)
REGISTERED IN AB. & SASK.
DESIGNED 3 PHASE/DRESSED 3 PHASE

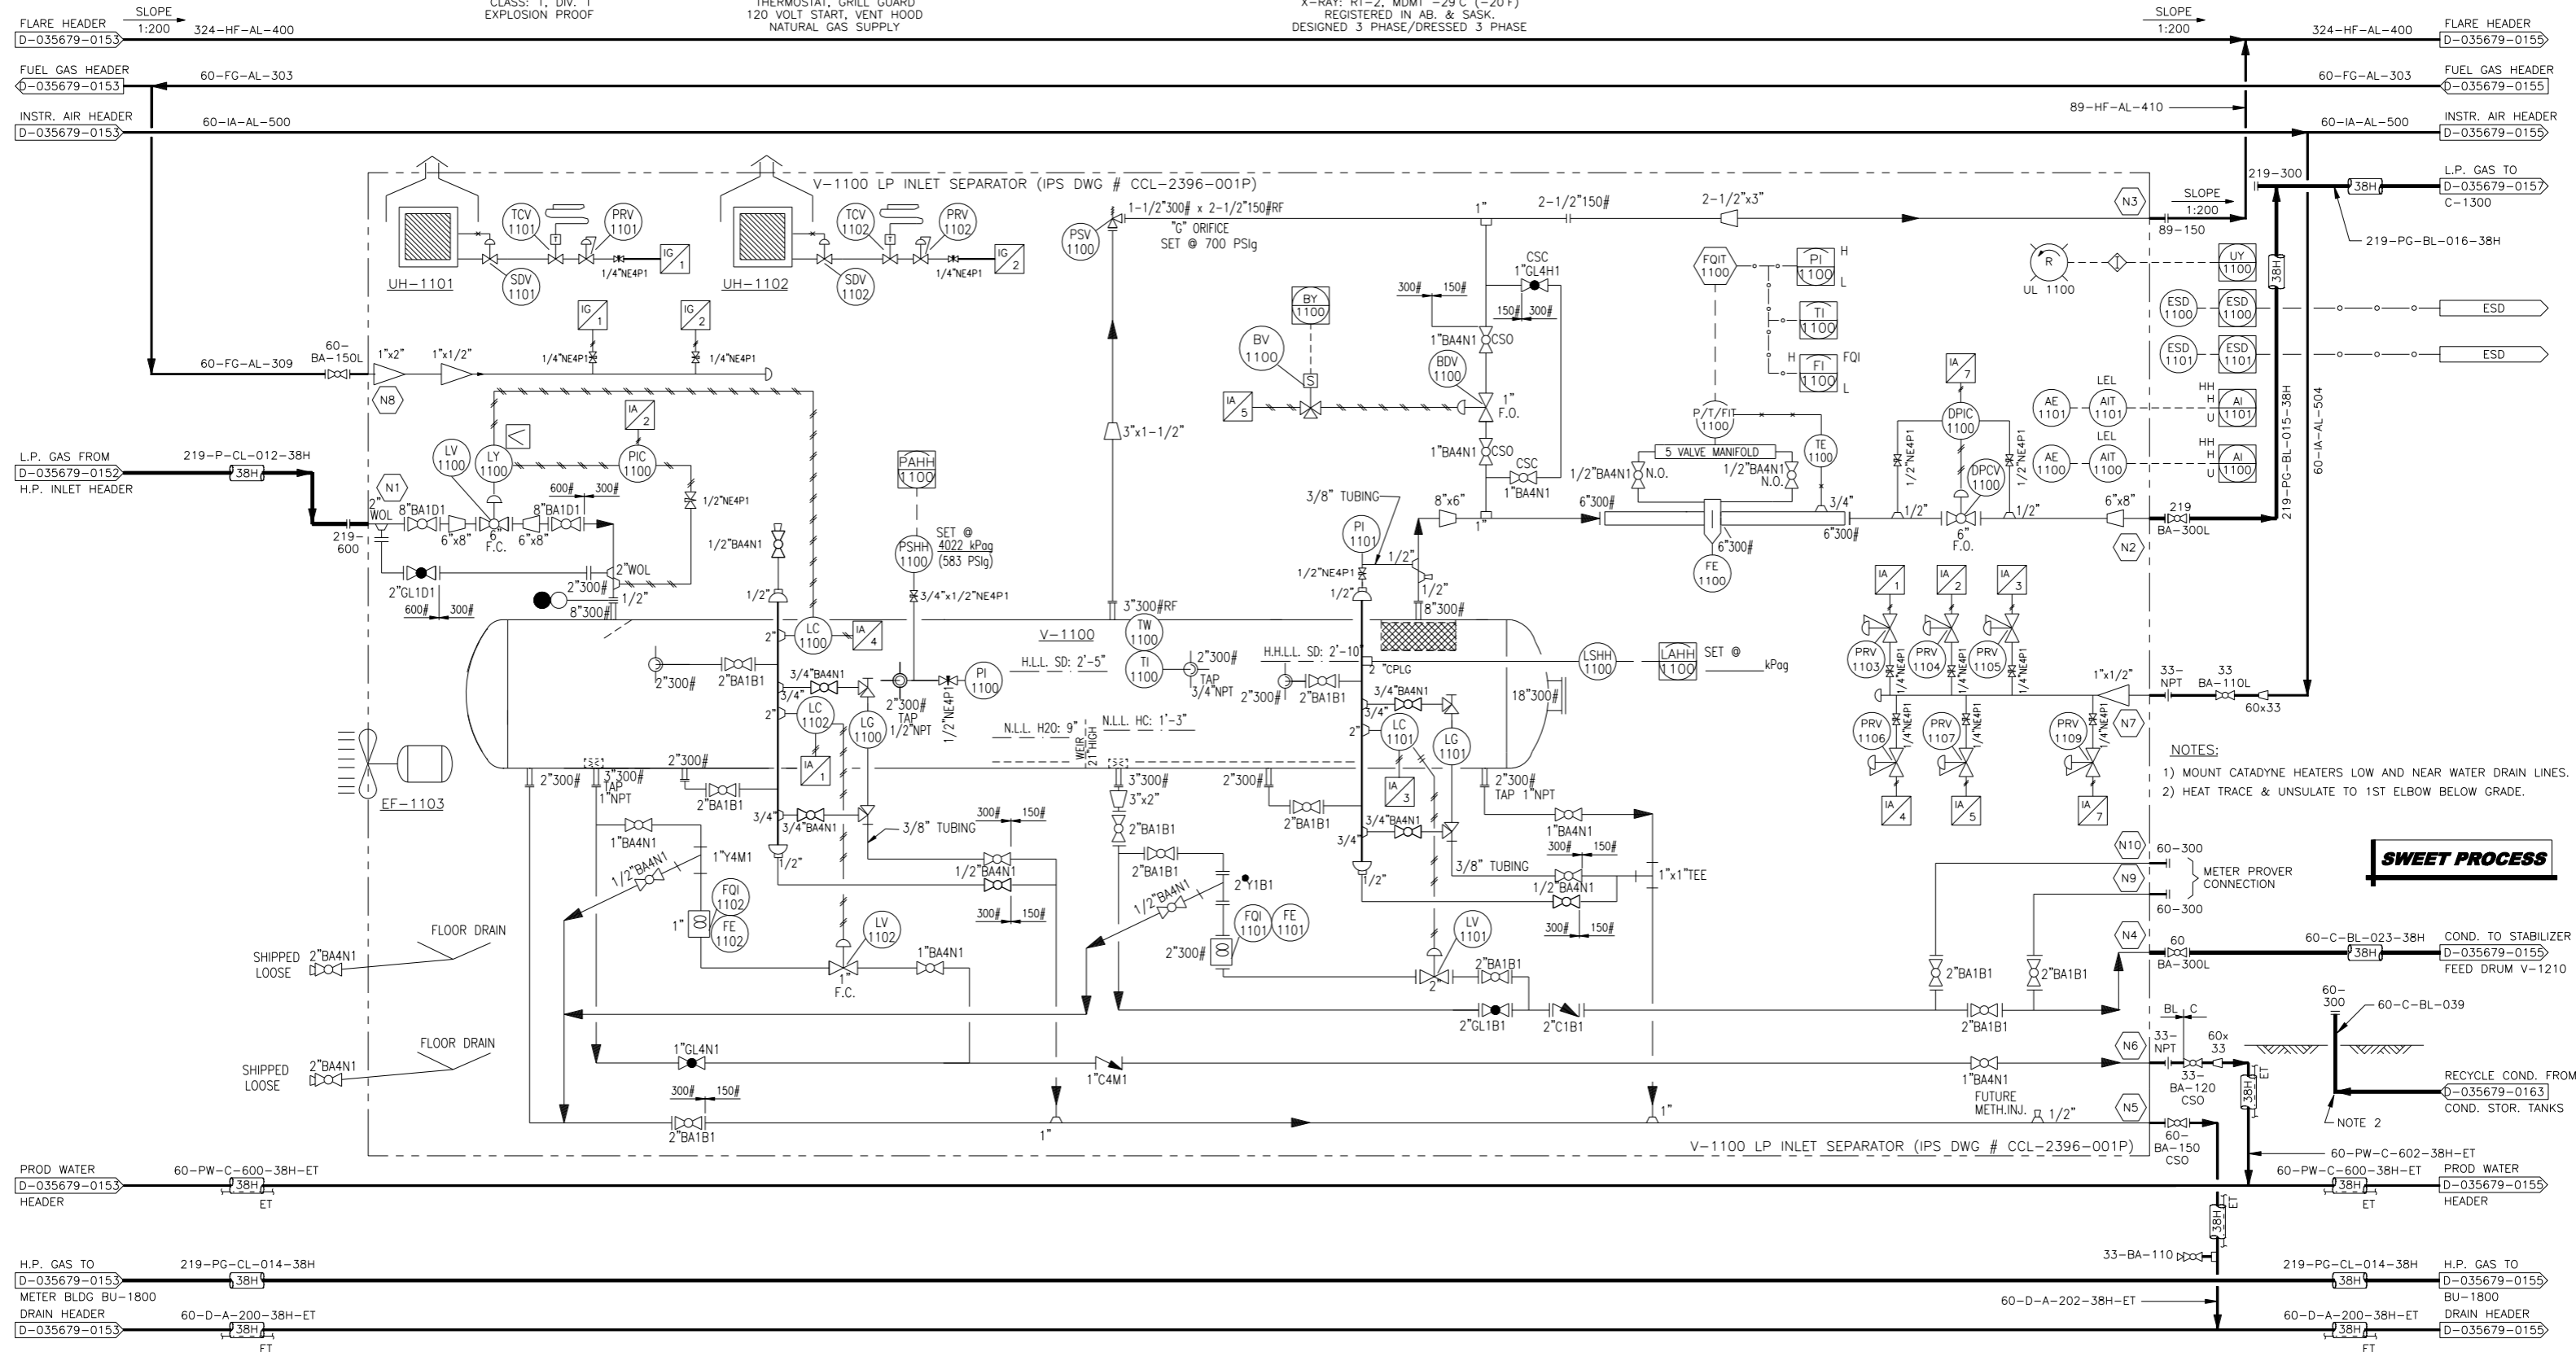

- NOTES:
- 1) MOUNT CATADYNE HEATERS LOW AND NEAR WATER DRAIN LINES.
 - 2) HEAT TRACE & UNSULATE TO 1ST ELBOW BELOW GRADE.

SWEET PROCESS

DWG. NO.	REFERENCE DRAWINGS	DEVON PROJECT	REV	REVISIONS	DATE	BY	CHK'D	APP'D	OWNR APP'D
035679			0	ISSUED FOR CONSTRUCTION	04.11.30	BD	MWL	HN	

ENGINEER AND PERMIT STAMPS

THIS DRAWING WAS
SIGNED AND STAMPED
BY HOWARD NELSON AT REV.0
ON 04.12.10

DESIGNED		
DRAWN	JL	03.11.10
CHECKED	MWL	04.12.01
PROCESS CK.		
MECH. CK.	HN	04.12.10
STRUCT. CK.		
ELECT. CK.		
OWNER APP.		
OWNER APP.		

devon
PINTO
COMPRESSOR STATION
L.P. INLET SEPARATOR AREA P & ID
LSD 10-15-56-27 W5M

CONTR JOB NO	SCALE	DWG. NO.	DEVON PROJ.
03-126	NTS	D-035679-0154.DWG	035679

FILE: E:\Projects\Devon_Canada_Corp\03-126\PID\035679-0154.dwg shawn_brodeur TIME: 2006-09-28 15:33

