

**Canadian Natural Resources Limited
GENERAL PRESSURE VESSEL INFORMATION**

Job# 10.111397

District: Fort St. John North	Skid No.
Facility: North Nig Compressor	Location (LSD): b-97-H/94-H-04
Vessel Name Equipment Number: Glycol Contactor	
Orientation: Vertical	
Status: In Service	Regulatory Inspection

PRESSURE VESSEL NAMEPLATE DATA

"A" or "G" or "S" (Sask.) or BC Registration Number. C47862		CRN Number: H 5934.12	
Vessel serial number: 4234		Size: 32 inch x 32 ft.	
Shell thickness: 28.6mm		Shell material: SA 516 70N	
Head thickness: 27.1mm		Head material: SA 516 70N	
Tube wall thickness:		Tube material:	
Tube diameter:		Tube length:	
Channel thickness:		Channel material:	
Design pressure	Shell: 1415 PSI	Operating pressure	Shell:
	Tubes:		Tubes:
Design Temp.	Shell: 100° F	Operating temperature	Shell:
	Tubes:		Tubes:
X-ray: RT 1		Heat treatment: yes	
Code parameters: ASME VIII, DIV 1		Coated: No	
Manufacturer: ARGO		Year built: 1994	
Corrosion allowance: 1.6mm		Manway: No	

PRESSURE SAFETY VALVE NAMEPLATE DATA

PSV Tag Shell	Manufacture // Model // Serial	Set Pressure (PSI / kPa)	Capacity (scfm / usgpm)	Block Valve	Size	Location	Service by / Date
n/s	Taylor // 82G12551311 // 004224-127	1000 PSI	6504 SCFM	No	1.5 x 2	Mid Shell	DALCO - 8/2011
PSV Tag Tube	Manufacture // Model // Serial	Set Pressure (PSI / kPa)	Capacity (scfm / usgpm)	Block Valve	Size	Location	Service by / Date

SERVICE CONDITIONS-INDICATE ALL THAT APPLY

Sweet X	Sour	Oil	Gas X	Water X
Amine	LPG	Condensate	Air	Glycol X

Other (Describe):

Inspection Interval _____ **PSV Service Interval** _____

(Determined by MIC in conjunction with Chief Inspector following guidelines of CNRL's Owner-User Inspection Program)

Reports reviewed and accepted by:

Mechanical Integrity Coordinator _____ **Date** _____

Fill out all forms as completely as possible. All information is important! Use back of sheets to record additional information or sketch if required.

Copy of report to be filed by MIC at site, and copy sent to Chief Inspector

External Inspection Items	G	F	P	N/A	Comments
Insulation Verify sealed around manways, nozzles, no damage present, and there is no egress of moisture.	X				Vessel is not insulated
External Condition Assess paint condition, areas peeling, record any corrosion, damage, etc (record location, size and depth of corrosion or damage)	X				Paint in good overall condition – No exposed metal – no corrosion.
Leakage Record any leakage at flanges, threaded joints, weep holes on repads, etc.	X				No leaks observed
Skirt: Assess condition of paint, fire protection, and concrete. Look for corrosion, buckling, dents, etc. Look at vessel surface area near supports. Verify no signs of leakage at attachment to vessel and attachment welds are acceptable. Ground wire attached?	X				Skirt is bolted to skid floor - No corrosion at attachment welds to vessel – No leaks - No buckling or dents Ground wire attached to skid
Anchor Bolts Hammer tap to ensure secure. Look for cracking in treads or signs of deformation.	X				Anchor bolts are securely fastened - no sign of deformation
Concrete foundation Check for cracks, spalling, etc.				X	None.
Ladder / Platform Describe general condition, ensure support is secure to vessel, describe any hazards.		X			Bottom attachment of ladder is bent out of place – rest of the ladder is secure
Nozzle Assess paint, look for leakage, and ensure stud threads are fully engaged. Record any damage, deflection, etc. Are nozzles gusseted?	X				Paint in good condition - Stud threads are fully engaged - No damage or deflections observed – no leaks. Nozzles are not gusseted.
Gauges Ensure gauges are visible, working, no leakage, and suitable for range of MAWP/Temp.	X				Pressure gauge: 0 – 2000 PSI Temp gauge: -40 – 160 F
External Piping Ensure pipe is well supported. All clamps, supports, shoes, etc. in place. Look for evidence of structural overload, deflection, etc. Paint condition, external corrosion?	X				Piping is well supported - No signs of structural overload, all clamps and supports are in place. Paint in good overall condition – no corrosion
Valving Ensure no leaks are visible. Valves are properly supported and chained if necessary.		X			Valves are properly supported – No leaks
PSV Ensure PSV is set at pressure at or below that of vessel.	X				Located on upper shell – set below the vessel MAWP - No block valve present - Seal is intact - PSV vents to closed header.
NDE methods Was UT/ MPI done on vessel (MI coordinator to review results)	X				Ultrasonic thickness survey carried out-no metal thickness detected below nominal minus corrosion allowance.
<p>Recommendations or corrective actions : Vessel is Fit for Service or describe corrective actions required) (MIC to review corrective actions with Operations, discuss with Chief Inspector where necessary, and get remedial action implemented)</p> <p>Recommendations: Summary: This vessel is in good over all condition, visual external and ultrasonic thickness survey carried out-no metal thickness detected below nominal minus corrosion allowance. Long term corrosion rate based on greatest thickness loss (shell) 0.056mm per year. Retirement Date to “T”min is year 2084.</p> <p>Vessel is fit for service.</p>					


Inspected By: Andrew Neis / D. Wiedman

Date: March 6, 2012

Photo Table



Data plate

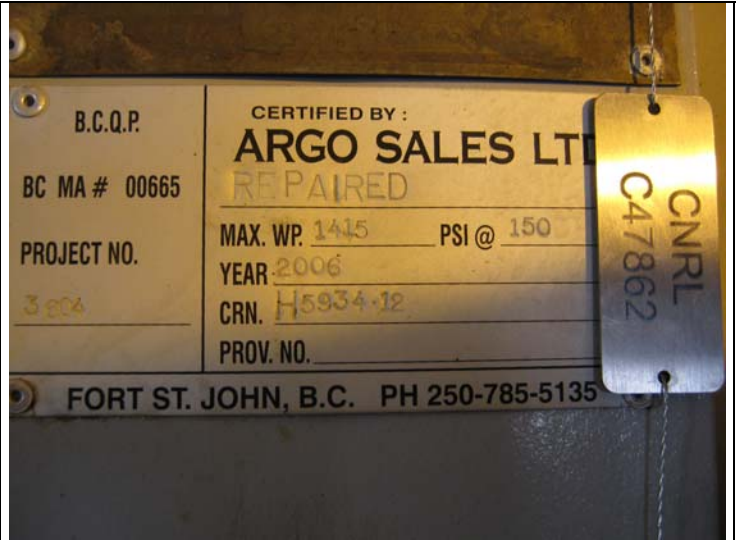

Data plate



Overview



Overview



Temp Gauge



Pressure Gauge



Ladder Support bent – bolts missing



Ladder Support bent



PSV

PSV