

**Canadian Natural Resources Limited
GENERAL PRESSURE VESSEL INFORMATION**

Job # 10.110674

District: **Grande Prairie, AB** Skid No.:

Facility: **Saddle Hills Gas Gathering** Location (LSD): **13-27-75-07 w6m**

Vessel Name Equipment Number: **Line Heater**

Orientation: **Horizontal**

Status: **In Service** **Regulatory Inspection**

PRESSURE VESSEL NAMEPLATE DATA

“A” or “G” or “S” (Sask.) or BC Registration Number: **A0459237** CRN Number: **K 1977.12**

Vessel serial number: 123-85-00 Size: 36 in x 16 ft

Shell thickness: 6.4 mm Shell material: SA 36

Head thickness: 6.4 mm Head material: SA 36

Tube wall thickness: Tube material: SA106 B

Tube diameter: Tube length:

Channel thickness: Channel material:

Design pressure	Shell: Atmos	Operating pressure	Shell:
	Tubes: Pre: 20340 kPa (2950 PSI) Post: 13962 kPa (2025 PSI)		Tubes: 0 to 20684 kPa

Design Temp.	Shell: 93°C	Operating temperature	Shell: 10 to 150°C
	Tubes:		Tubes:

X-ray: RT-1 Heat treatment: HT

Code parameters: ASME B31.3 Coated: No

Manufacturer: Mar-Quinn Industries Ltd. Year built: 2000

Corrosion allowance: 3.2 mm Manway: Removable end plates

PRESSURE SAFETY VALVE NAMEPLATE DATA

PSV Tag #	Manufacturer	Model #	Serial #	Set Pressure (PSI)	Capacity (scfm)	Service Date
Not Required						

CRN #	Service By	Block Valve	Location	Size	Code Stamp

SERVICE CONDITIONS-INDICATE ALL THAT APPLY

Sweet	Sour X	Oil	Gas X	Water
Amine	LPG	Condensate	Air	Glycol

Other (Describe):

Inspection Interval _____ **PSV Service Interval** _____

(Determined by MIC in conjunction with Chief Inspector following guidelines of CNRL Owner-User Inspection Program)

Reports reviewed and accepted by:
Mechanical Integrity Coordinator _____ **Date** _____

External Inspection Items	G	F	P	N/A	Comments
Insulation Verify sealed around manways, nozzles, no damage present, and there is no egress of moisture.		X			Vessel is 80% insulated. Cladding is not sealed at expansion tank Wall closure sealed – no egress of moisture.
External Condition Assess paint condition, areas peeling, record any corrosion, damage, etc (record location, size and depth of corrosion or damage)	X				Minor paint abrasion to 5% exposed metal. No damage. No corrosion.
Leakage Record any leakage at flanges, threaded joints, weep holes on repads, etc.	X				No leaks observed.
Saddle/Skirt Assess condition of paint, fire protection, concrete. Look for corrosion, buckling, dents, etc. Look at vessel surface area near supports. Verify no signs of leakage at attachment to vessel and attachment welds are acceptable. Ground wire attached?	X				Vessel saddle is bolted to skid. No evidence of corrosion at shell to saddle weld – no leaks. Paint in good condition – no exposed metal. No distortion. No buckles. Skid package is mounted to pilings above ground level. Skid package has ground wire attached.
Anchor Bolts Hammer tap to ensure secure. Look for cracking in treads or signs of deformation.	X				Anchor bolts are securely fastened.
Concrete foundation Check for cracks, spalling, etc.				X	Steel skid.
Ladder / Platform Describe general condition, ensure support is secure to vessel, describe any hazards.				X	No ladder attached.
Nozzle Assess paint, look for leakage, and ensure stud threads are fully engaged. Record any damage, deflection, etc. Are nozzles gusseted?	X				Threaded nozzle joints are fully engaged. Studs are fully engaged to nuts – no short bolts. Nozzles are not gusseted. No damage. No deflections. Paint chipping to 5% exposed metal with minor corrosion
Gauges Ensure gauges are visible, working, no leakage, and suitable for range of MAWP/ Temp.		X			Pressure, temperature and liquid level gauges attached. Pressure gauge: 0 to 20685 kPa. Within range of MAWP Gauge glass is cracked Temperature gauge: 10 to 150°C. Within range of MAWT Clean, clear and in working condition. No leaks.
External Piping Ensure pipe is well supported. All clamps, supports, shoes, etc. in place. Look for evidence of structural overload, deflection, etc. Paint condition, external corrosion?	X				Piping is well supported. All clamps, supports and shoes are in place. No structural overloads or deflections noted. Paint chipped to 10% exposed metal.
Valving Ensure no leaks are visible. Valves are properly supported and chained if necessary.	X				Valves are properly supported. No leak detected.
PSV Ensure PSV is set at pressure at or below that of vessel.				X	Not required.
NDE methods Was UT/ MPI done on vessel (MI coordinator to review results)	X				Ultrasonic thickness survey carried out – no metal thickness detected below nominal minus corrosion allowance.
Other					
Recommendations or corrective actions : Vessel is Fit for Service or describe corrective actions required) (MIC to review corrective actions with Operations, discuss with Chief Inspector where necessary, and get remedial action implemented) Recommendations: 1. Seal cladding at expansion tank. 2. Replace pressure gauge on inlet piping. Summary: Vessel is in overall good condition, visual external inspection and ultrasonic corrosion survey performed – no metal thickness detected below nominal minus corrosion allowance. Long term corrosion rate based on greatest thickness loss – no corrosion rate to assess. Vessel is fit for service.					

Inspected By: Chris Maxsom

Date: September 9, 2011





LSD

Overview – Skid



Overview – Vessel

Overview - Vessel

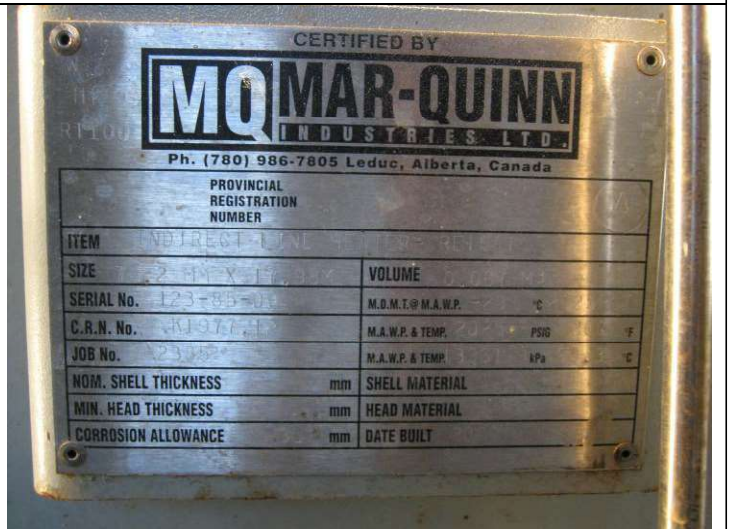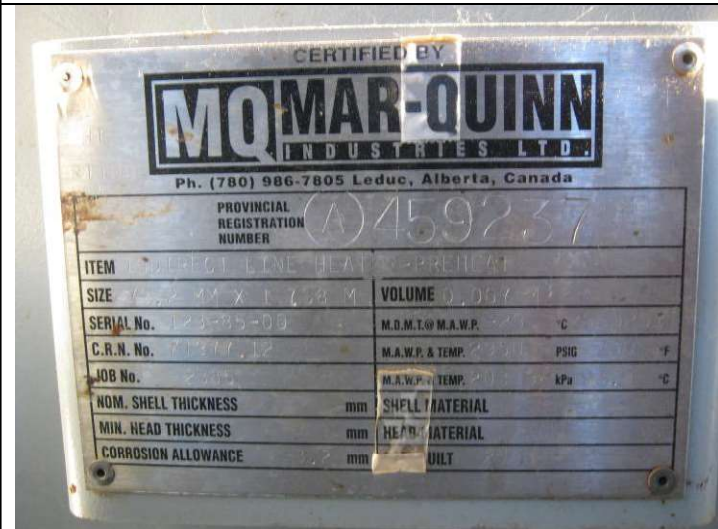

Data plate 1

Data plate 2



Expansion tank with liquid level

Saddle



Inlet temperature gauge

Inlet pressure gauge



Closure not sealed around expansion tank