

**Canadian Natural Resources Limited
GENERAL PRESSURE VESSEL INFORMATION**

Job # 10.110056

| | |
|--|---|
| District: Grande Prairie AB. | Skid No. |
| Facility: Knopcik Gas Gathering | Location (LSD): 102 / 06-02-74-11W6M |
| Vessel Name Equipment Number: Line Heater | |
| Orientation: Horizontal | |
| Status: In Service | Regulatory Inspection |

PRESSURE VESSEL NAMEPLATE DATA

| | | | |
|---|--------------------------------|-------------------------|------------------------|
| "A" or "G" or "S" (Sask.) or BC Registration Number. A0437716 | | CRN Number: N 6863.2 | |
| Vessel serial number: L-270 | | Size: 32 in. X 10 ft. | |
| Shell thickness: 9.5mm | | Shell material: SA 36 | |
| Head thickness: 9.5mm | | Head material: SA 36 | |
| Tube wall thickness: | | Tube material: | |
| Tube diameter: | | Tube length: | |
| Channel thickness: | | Channel material: | |
| Design pressure | 1 st Pass: 3000 PSI | Operating pressure | Shell: |
| | 2 nd Pass: 3000 PSI | | Tubes: |
| Design Temp. | Shell: 200 Deg F | Operating temperature | Shell: 50 – 500 Deg F. |
| | Tubes: 200 Deg F | | Tubes: |
| X-ray: RT 1 | | Heat treatment: HT | |
| Code parameters: ASME B31.3 | | Coated: no | |
| Manufacturer: Argo Sales Ltd. | | Year built: 1997 | |
| Corrosion allowance: 12.5% | | Manway: no | |

PRESSURE SAFETY VALVE NAMEPLATE DATA

| PSV Tag # | Manufacture | Model # | Serial # | Set Pressure (kPa) | Capacity (scfm) | Service Date |
|-----------|-------------|-------------|----------|-----------------------|--------------------|-----------------|
| | | | | | | |
| CRN # | Service By | Block Valve | Location | Size | Code Stamp | |
| | | | | | | |

SERVICE CONDITIONS-INDICATE ALL THAT APPLY

| | | | | |
|-------|---------------|------------|--------------|--------|
| Sweet | Sour X | Oil | Gas X | Water |
| Amine | LPG | Condensate | Air | Glycol |

Other (Describe):

Inspection Interval _____ **PSV Service Interval** _____
(Determined by MIC in conjunction with Chief Inspector following guidelines of CNRL Owner-User Inspection Program)

Reports reviewed and accepted by:
Mechanical Integrity Coordinator _____ **Date** _____

Fill out all forms as completely as possible. All information is important! Use back of sheets to record additional information or sketch if required.
Copy of report to be filed by MIC at site, and copy sent to Chief Inspector

| External Inspection Items | G | F | P | N/A | Comments |
|--|---|---|---|-----|--|
| Insulation Verify sealed around manways, nozzles, no damage present, and there is no egress of moisture. | X | | | | No damage present- no egress of moisture. Sealed around nozzles, skid shed and saddles. |
| External Condition Assess paint condition, areas peeling, record any corrosion, damage, etc (record location, size and depth of corrosion or damage) | X | | | | Paint in good overall condition – No exposed metal. |
| Leakage Record any leakage at flanges, threaded joints, weep holes on repads, etc. | X | | | | No leaks observed. |
| Saddle/Skirt Assess condition of paint, fire protection, concrete. Look for corrosion, buckling, dents, etc. Look at vessel surface area near supports. Verify no signs of leakage at attachment to vessel and attachment welds are acceptable. Ground wire attached? | X | | | | Saddles: Bolted directly to skid frame. No buckling or dents. No corrosion at attachment welds to vessel. Ground wire attached to skid frame. |
| Anchor Bolts Hammer tap to ensure secure. Look for cracking in treads or signs of deformation. | X | | | | Anchor bolts are securely fastened to skid floor. No deformation. |
| Concrete foundation Check for cracks, spalling, etc. | | | | X | |
| Ladder / Platform Describe general condition, ensure support is secure to vessel, describe any hazards. | | | | X | |
| Nozzle Assess paint, look for leakage, and ensure stud threads are fully engaged. Record any damage, deflection, etc. Are nozzles gusseted? | X | | | | Stud threads are fully engaged to nuts- no short bolting. No damage or deflections – no leaks. Nozzles are not gusseted. |
| Gauges Ensure gauges are visible, working, no leakage, and suitable for range of MAWP/ Temp. | X | | | | Clear and clean – no leakage. Suitable for operational range of vessel. Temperature gauge 50 – 500 Deg F. |
| External Piping Ensure pipe is well supported. All clamps, supports, shoes, etc. in place. Look for evidence of structural overload, deflection, etc. Paint condition, external corrosion? | X | | | | Piping is well supported; no deflection, all clamps and supports are in place. Piping insulated – no damage present. |
| Valve: Ensure no leaks are visible. Valves are properly supported and chained if necessary. | X | | | | Valves are supported properly – no leaks. |
| PSV Ensure PSV is set at pressure at or below that of vessel. | | | | X | No PSV. |
| NDE methods Was UT/ MPI done on vessel (MI coordinator to review results) | X | | | | Ultrasonic thickness survey carried out – no metal thickness detected below nominal. |
| <p>Recommendations or corrective actions : Vessel is Fit for Service or describe corrective actions required) (MIC to review corrective actions with Operations, discuss with Chief Inspector where necessary, and get remedial action implemented) Recommendations: No recommendations at this time. Summary: Vessel is in overall good condition, visual external inspection and ultrasonic corrosion survey performed – no metal thickness detected below nominal. Long term corrosion rate based on greatest thickness loss – no corrosion rate to assess.</p> <p>Vessel is fit for service.</p> | | | | | |


Inspected By: Gerry Avery

Date: March 9, 2011


Photo Table



LSD

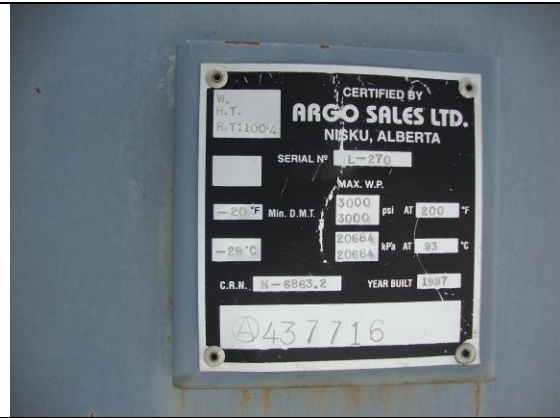

Vessel data plate

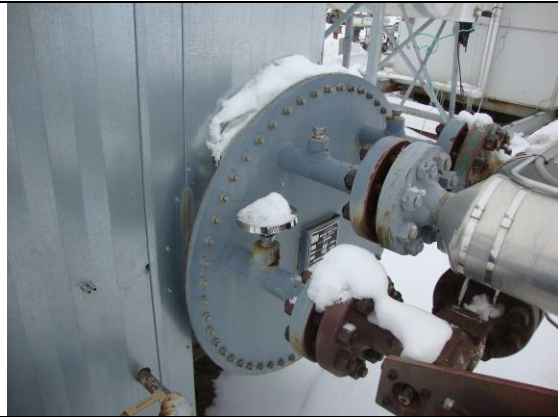

Vessel inlet



Vessel temperature gauge



Vessel overview