

**Canadian Natural Resources Limited
GENERAL PRESSURE VESSEL INFORMATION**

Job # 10.110056

District: Grande Prairie AB.	Skid No.
Facility: Knopcik Gas Gathering	Location (LSD): 16-36-72-11W6M
Vessel Name Equipment Number: Line Heater	
Orientation: Horizontal	
Status: In Service	Regulatory Inspection

PRESSURE VESSEL NAMEPLATE DATA

"A" or "G" or "S" (Sask.) or BC Registration Number. A0438942		CRN Number: N 9595.213	
Vessel serial number: 2133CB6		Size: 54 in. X 20 ft.	
Shell thickness: 6.4mm		Shell material: SA 36	
Head thickness: 6.4mm		Head material: SA 36	
Tube wall thickness:		Tube material: SA 106-B	
Tube diameter:		Tube length:	
Channel thickness:		Channel material:	
Design pressure	Shell: 21057 Kpa	Operating pressure	Shell:
	Tubes: 12500 Kpa		Tubes: 0 – 5000 PSI
Design Temp.	Shell: 93Deg C	Operating temperature	Shell:
	Tubes: 93 Deg C		Tubes: 0 – 250 Deg F.
X-ray: RT 1		Heat treatment: yes	
Code parameters: ASME B31.3		Coated: no	
Manufacturer: Plains Oil Ltd.		Year built: 1998	
Corrosion allowance:		Manway: no	

PRESSURE SAFETY VALVE NAMEPLATE DATA

PSV Tag #	Manufacture	Model #	Serial #	Set Pressure (kPa)	Capacity (scfm)	Service Date
CRN #	Service By	Block Valve	Location	Size	Code Stamp	

SERVICE CONDITIONS-INDICATE ALL THAT APPLY

Sweet	Sour X	Oil	Gas X	Water X
Amine	LPG	Condensate X	Air	Glycol

Other (Describe):

Inspection Interval _____ **PSV Service Interval** _____

(Determined by MIC in conjunction with Chief Inspector following guidelines of CNRL Owner-User Inspection Program)

Reports reviewed and accepted by:

Mechanical Integrity Coordinator _____ **Date** _____


Fill out all forms as completely as possible. All information is important! Use back of sheets to record additional information or sketch if required.
Copy of report to be filed by MIC at site, and copy sent to Chief Inspector

External Inspection Items	G	F	P	N/A	Comments
Insulation Verify sealed around manways, nozzles, no damage present, and there is no egress of moisture.	X				Vessel insulated to 80% of area. No damage or egress of moisture. Sealed around nozzles, saddles and skid building.
External Condition Assess paint condition, areas peeling, record any corrosion, damage, etc (record location, size and depth of corrosion or damage)	X				Paint in good overall condition – No exposed metal.
Leakage Record any leakage at flanges, threaded joints, weep holes on repads, etc.	X				No leaks observed.
Saddle/Skirt Assess condition of paint, fire protection, concrete. Look for corrosion, buckling, dents, etc. Look at vessel surface area near supports. Verify no signs of leakage at attachment to vessel and attachment welds are acceptable. Ground wire attached?	X				Saddles: bolted directly to skid floor. No buckling or dents. No corrosion at attachment welds to vessel. Ground wire attached to skid.
Anchor Bolts Hammer tap to ensure secure. Look for cracking in treads or signs of deformation.	X				Anchor bolts are securely fastened. No deformation.
Concrete foundation Check for cracks, spalling, etc.				X	
Ladder / Platform Describe general condition, ensure support is secure to vessel, describe any hazards.				X	
Nozzle Assess paint, look for leakage, and ensure stud threads are fully engaged. Record any damage, deflection, etc. Are nozzles gusseted?	X				Stud threads are fully engaged to nuts – no short bolts. No damage or deflections – no leaks. Nozzles are not gusseted.
Gauges Ensure gauges are visible, working, no leakage, and suitable for range of MAWP/ Temp.	X				Clear and clean – no leakage. Suitable for operational range of vessel. Pressure gauge 0 – 5000 PSI/temperature gauge 0 – 250 Deg F.
External Piping Ensure pipe is well supported. All clamps, supports, shoes, etc. in place. Look for evidence of structural overload, deflection, etc. Paint condition, external corrosion?	X				Piping is well supported; no deflection, all clamps and supports are in place. Paint in good condition – no exposed metal.
Valve: Ensure no leaks are visible. Valves are properly supported and chained if necessary.	X				Valves are supported properly – no leaks.
PSV Ensure PSV is set at pressure at or below that of vessel.				X	No PSV on vessel - vented to atmosphere.
NDE methods Was UT/ MPI done on vessel (MI coordinator to review results)	X				Ultrasonic thickness survey carried out – no metal thickness detected below nominal.
Other					
<p>Recommendations or corrective actions : Vessel is Fit for Service or describe corrective actions required) (MIC to review corrective actions with Operations, discuss with Chief Inspector where necessary, and get remedial action implemented) Recommendations: No recommendations at this time. Summary: Vessel is in overall good condition, visual external inspection and ultrasonic corrosion survey performed – no metal thickness detected below nominal. Long term corrosion rate based on greatest thickness loss – no corrosion rate to assess. Vessel is fit for service.</p>					

Photo Table



LSD

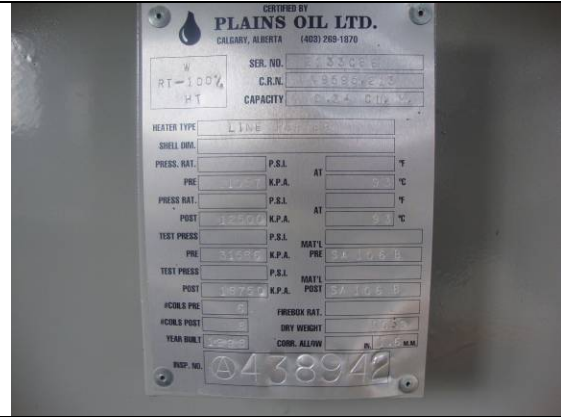

Vessel data plate



Vessel temperature gauge



Vessel pressure gauge



Inlet overview



Vessel overview